


TEMPORARY SERVICE ASSEMBLY FROM OVERHEAD DISTRIBUTION

CLASS 7 TREATED POLE OR
EQUIVALENT (4" X 4" MIN.
TREATED TIMBER)

1. 2 FEET LEAD WIRES MINIMUM
2. SERVICE ENTRANCE CABLE OR CONDUIT
WIRE SIZE NO. 8 MINIMUM
3. CENTER OF METER NOT MORE THAN 6'
OR LESS THAN 4' - 0" FROM GROUND
4. WEATHERPROOF OVERCURRENT PROTECTION
AND WEATHERPROOF RECEPTACLES IN
SEPARATE ENCLOSURES OR COMBINED IN A
SINGLE ENCLOSURE. TO INCLUDE GROUND
FAULT PROTECTION AS PER NEC.
5. NO. 6 CU. MINIMUM - 100A BREAKER OR LESS
NO. 4 CU. MINIMUM - 200A BREAKER
6. UNDERWRITERS APPROVED GROUND CLAMP

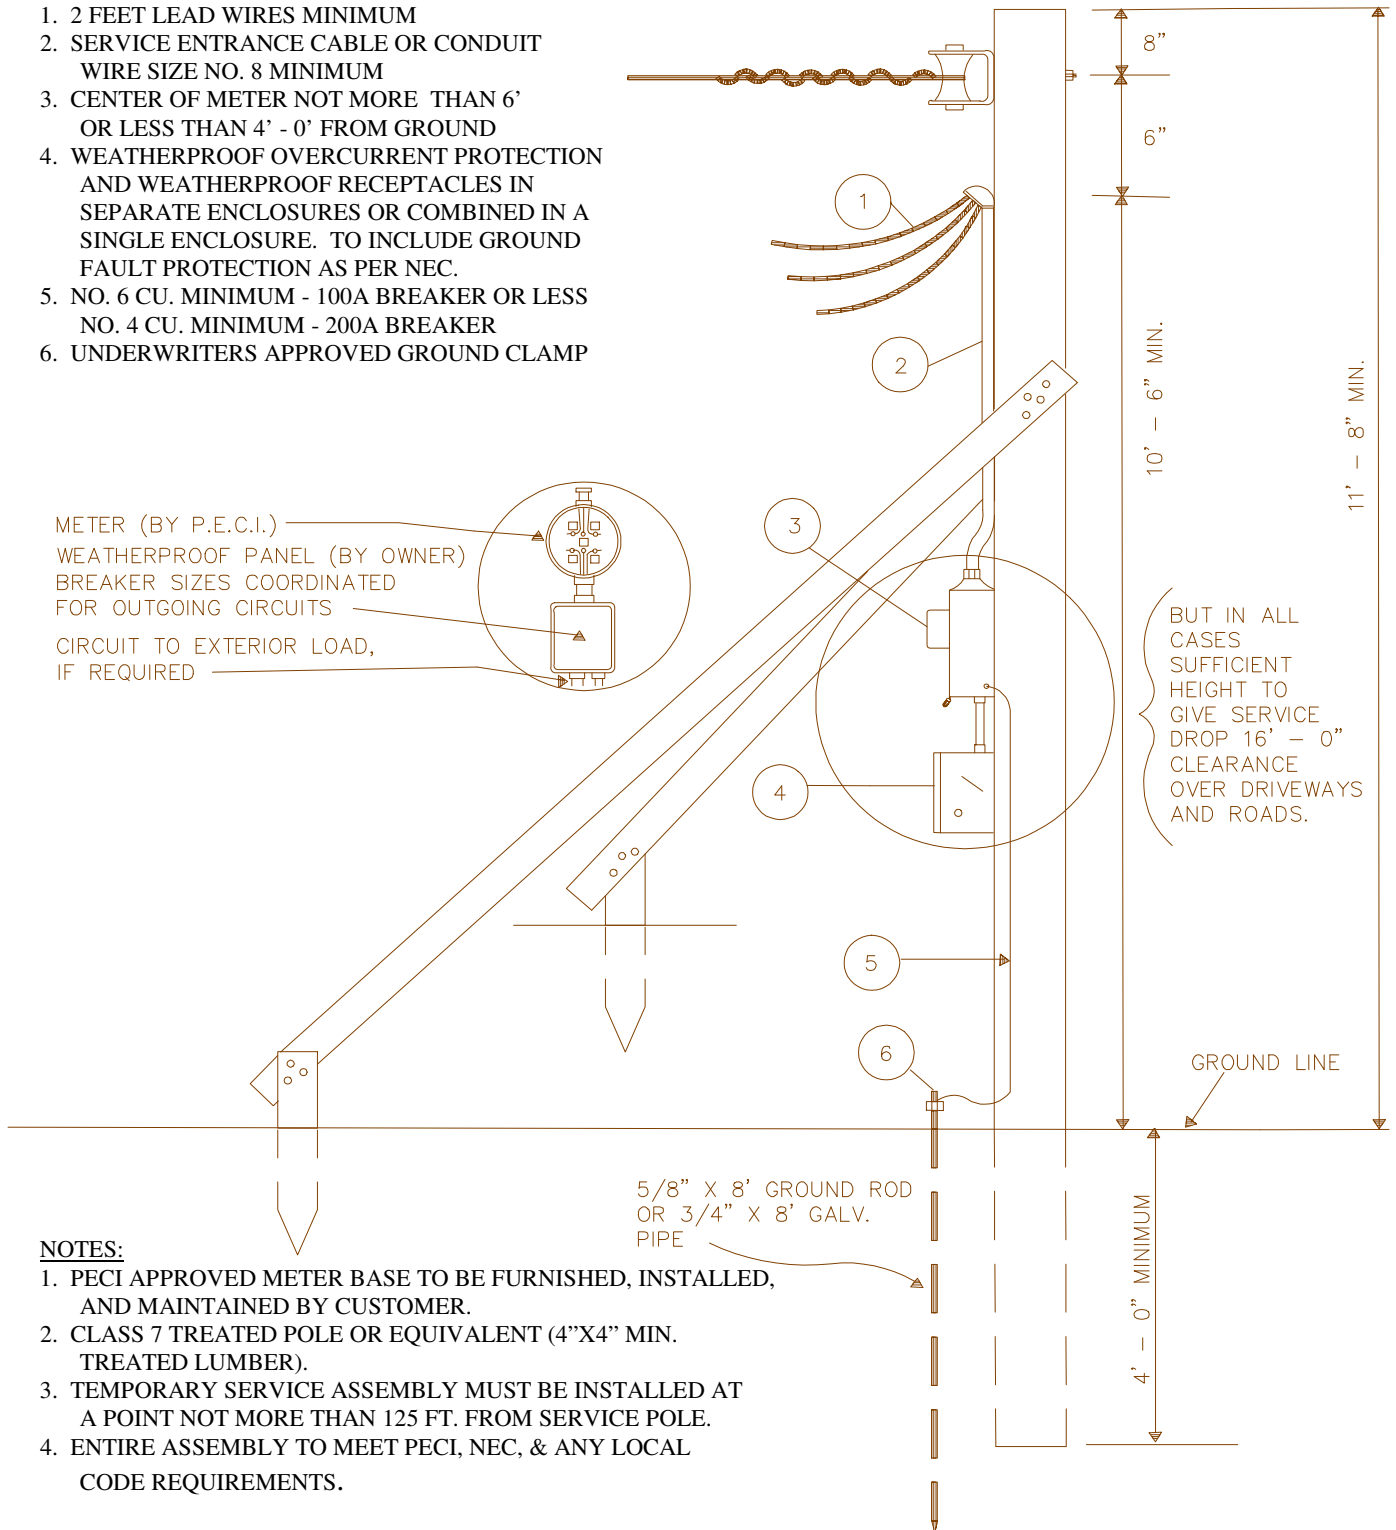

METER (BY P.E.C.I.)
WEATHERPROOF PANEL (BY OWNER)
BREAKER SIZES COORDINATED
FOR OUTGOING CIRCUITS
CIRCUIT TO EXTERIOR LOAD,
IF REQUIRED

BUT IN ALL
CASES
SUFFICIENT
HEIGHT TO
GIVE SERVICE
DROP 16' - 0"
CLEARANCE
OVER DRIVEWAYS
AND ROADS.

5/8" X 8' GROUND ROD
OR 3/4" X 8' GALV.
PIPE

NOTES:

1. PECE APPROVED METER BASE TO BE FURNISHED, INSTALLED,
AND MAINTAINED BY CUSTOMER.
2. CLASS 7 TREATED POLE OR EQUIVALENT (4"X4" MIN.
TREATED LUMBER).
3. TEMPORARY SERVICE ASSEMBLY MUST BE INSTALLED AT
A POINT NOT MORE THAN 125 FT. FROM SERVICE POLE.
4. ENTIRE ASSEMBLY TO MEET PECE, NEC, & ANY LOCAL
CODE REQUIREMENTS.

DATE: March 5, 1990
APPROVED BY: Wilson D. Saleeby
REV: February 19, 2014 SHEET 1

MEMO # 5

