


RESIDENTIAL C. T. CABINET

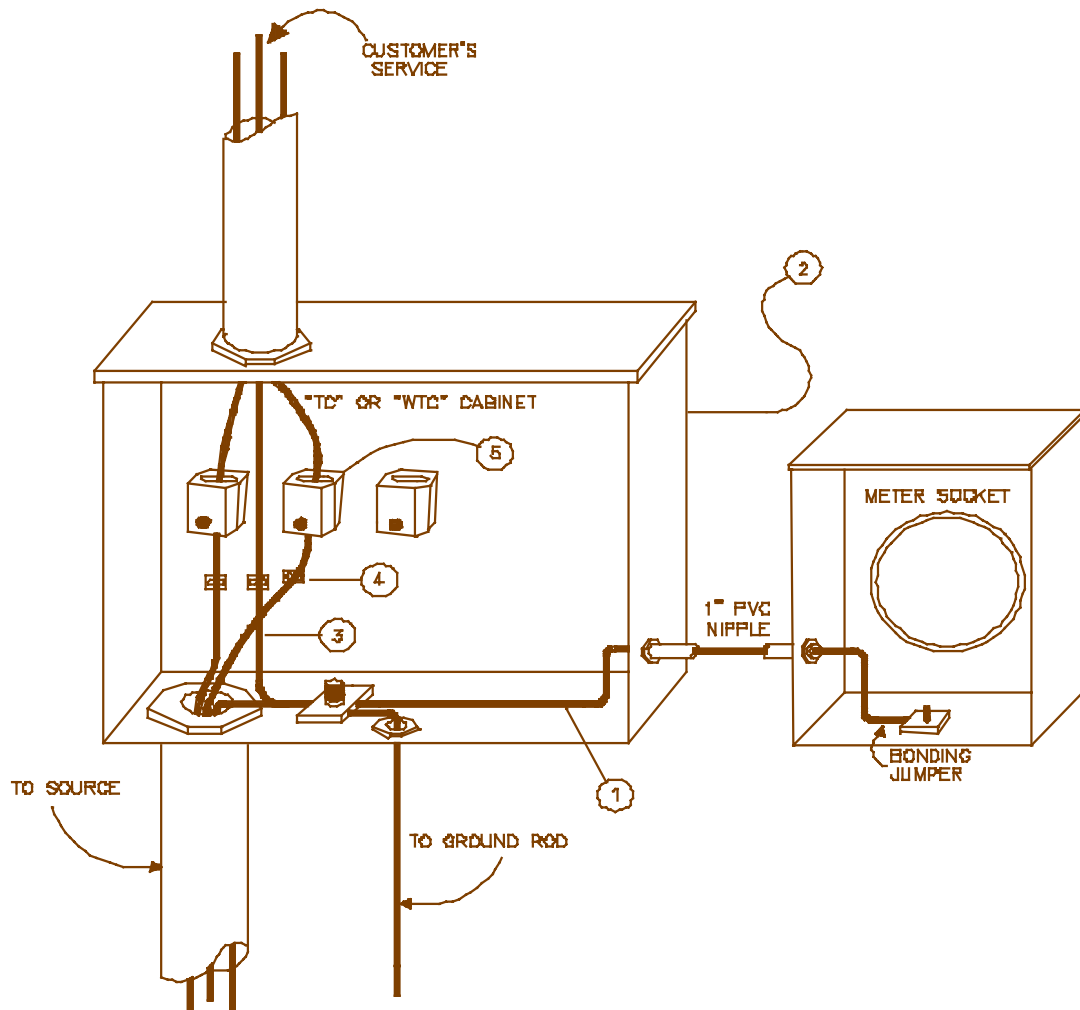

NOTES:

1. All metering cabinets and troughs to be bonded together with minimum #6 copper bonding wire.
2. C. T. Cabinets to be provided by owner/contractor. Minimum C. T. cabinet size is to be 24" x 24" x 12".
3. Both the owners service entrance conductors and the Cooperatives service cables are to be terminated in the cabinet.
4. Owner/contractor is responsible for providing Cooperative approved terminal blocks.
5. C. T. 's and meter socket to be provided by the Cooperative.
6. Entire assembly to meet PECCI , NEC, and local code requirements.

DATE: March 26, 1990
APPROVED BY: A. Berl Davis
REV: _____ SHEET 1

MEMO # 8

PALMETTO
ELECTRIC COOPERATIVE INC.
A Touchstone EnergySM Partner 